
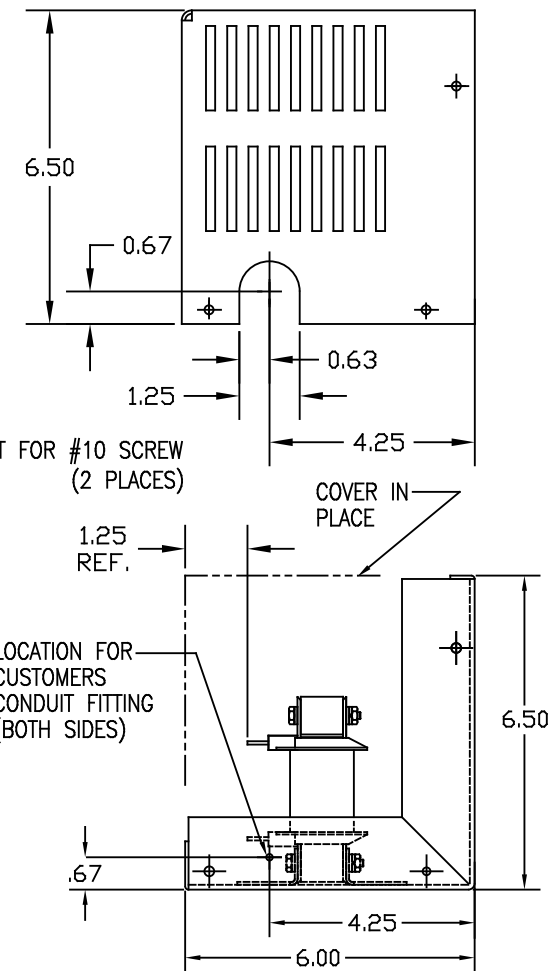
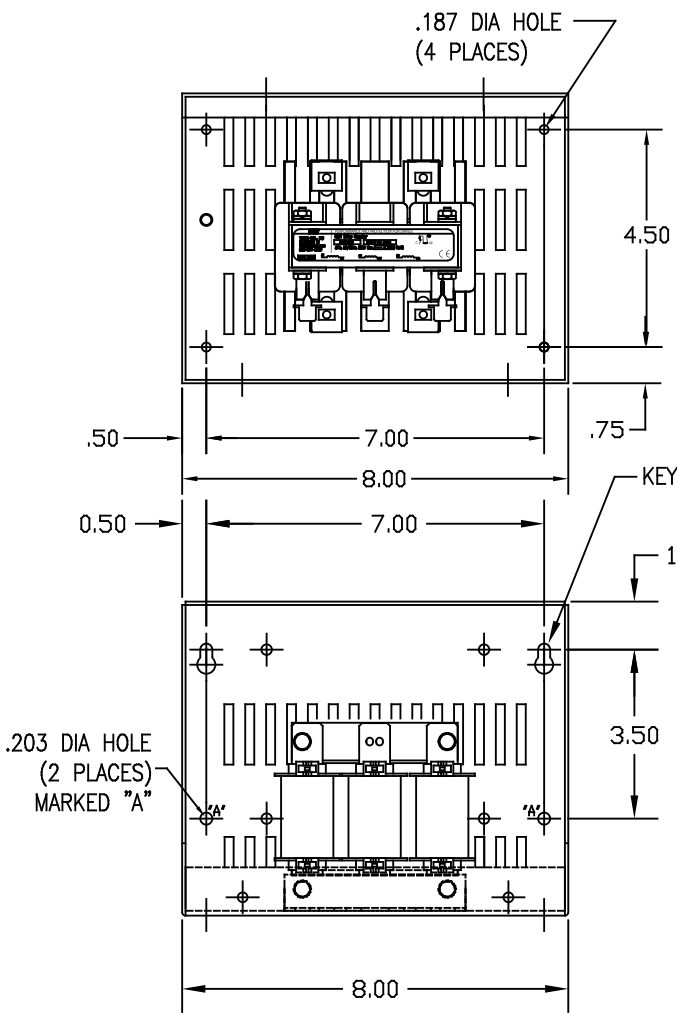


Performance and Protection for Drives  
**KLR Series Line Reactor**

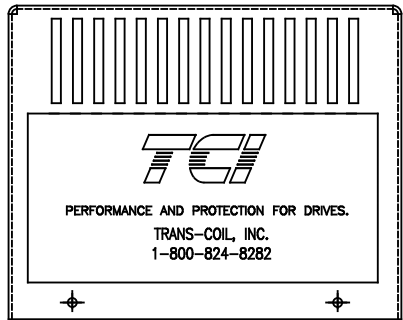

CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES.

|      |                    |            |           |               |               |
|------|--------------------|------------|-----------|---------------|---------------|
| 690V | NEC<br>MOTOR<br>HP | CATALOG NO | __AMPS(A) | APPROX WT-LBS | WATTS<br>LOSS |
| 3% Z | 1                  | KLR2DQD1V  | 2         | 8             | 9             |

| NO | REVISION | DATE | BY | TOLERANCES<br>(EXCEPT AS NOTED) |            |
|----|----------|------|----|---------------------------------|------------|
|    |          |      |    | DECIMAL                         | FRACTIONAL |
|    |          |      |    | .XX ±.03                        |            |
|    |          |      |    | .XXX±.010                       |            |
|    |          |      |    | FRACTIONAL<br>± 1/16            |            |
|    |          |      |    | ANGULAR<br>± 1/2°               |            |