








See V1K Installation Guide For Terminal Wire Size And Torque Information.

Note: Maintain Clearance of 3 Inches On All Sides To Other Equipment.


V1K Open Units

V1K Part Number	Max Voltage	Amps	Phase	Weight (LBS)
V1K2A00*	600	2	3	8
V1K3A00*	600	3	3	8
V1K4A00*	600	4	3	8
V1K6A00*	600	6	3	8
V1K8A00*	600	8	3	8
V1K12A00*	600	12	3	8

* = (Blank) - No Thermal Switch
 * = T - Thermal Switch Option

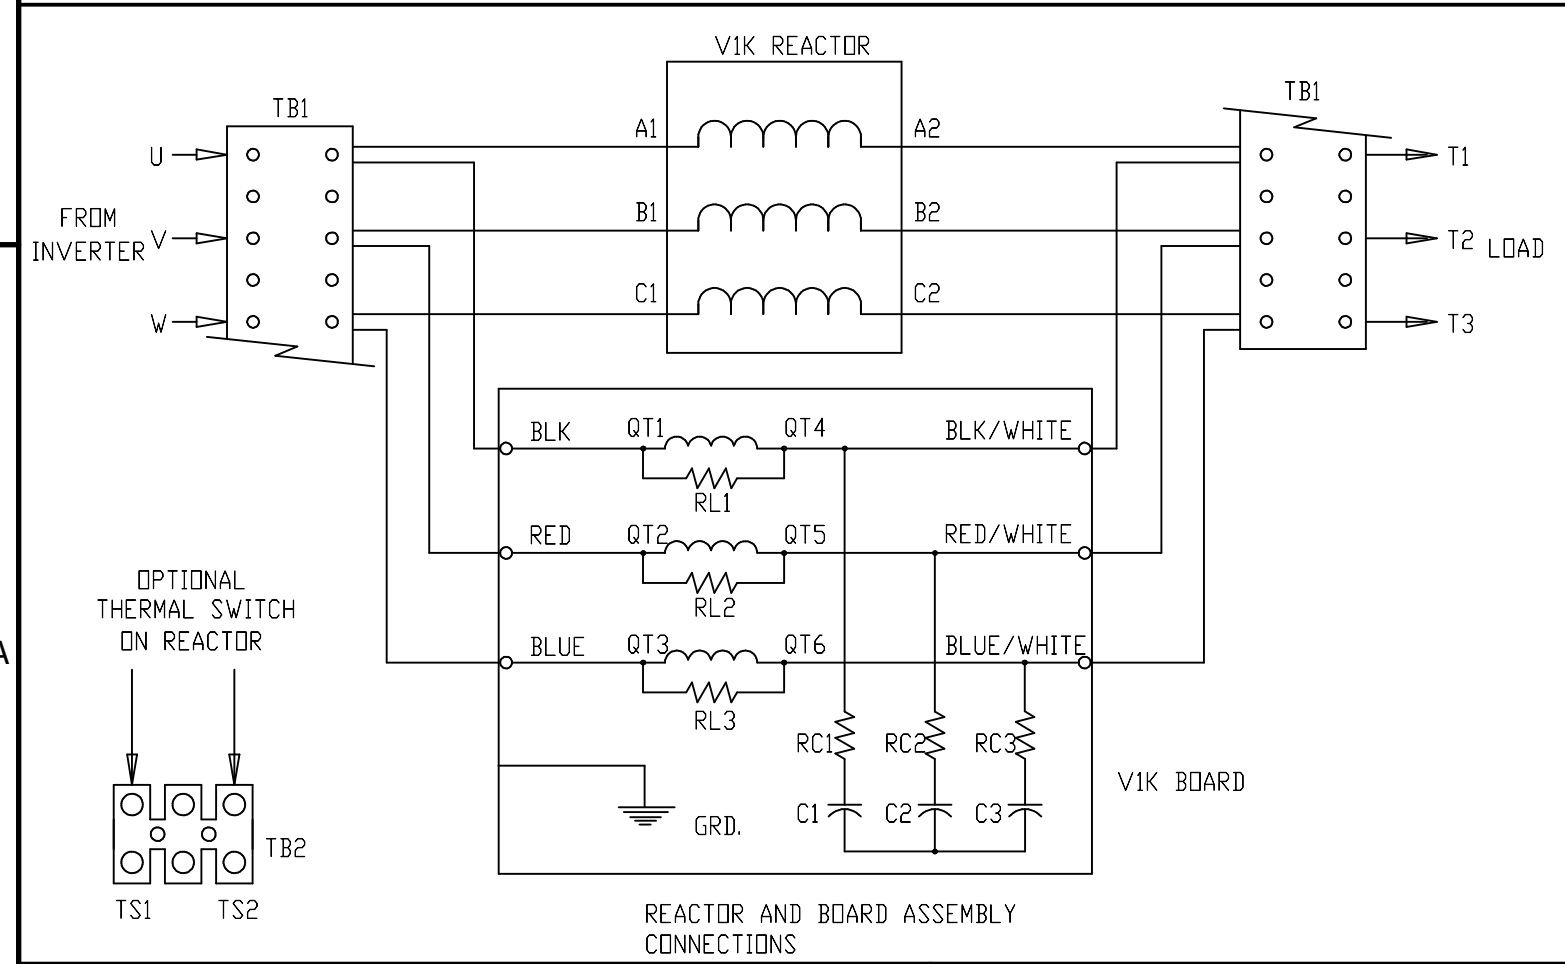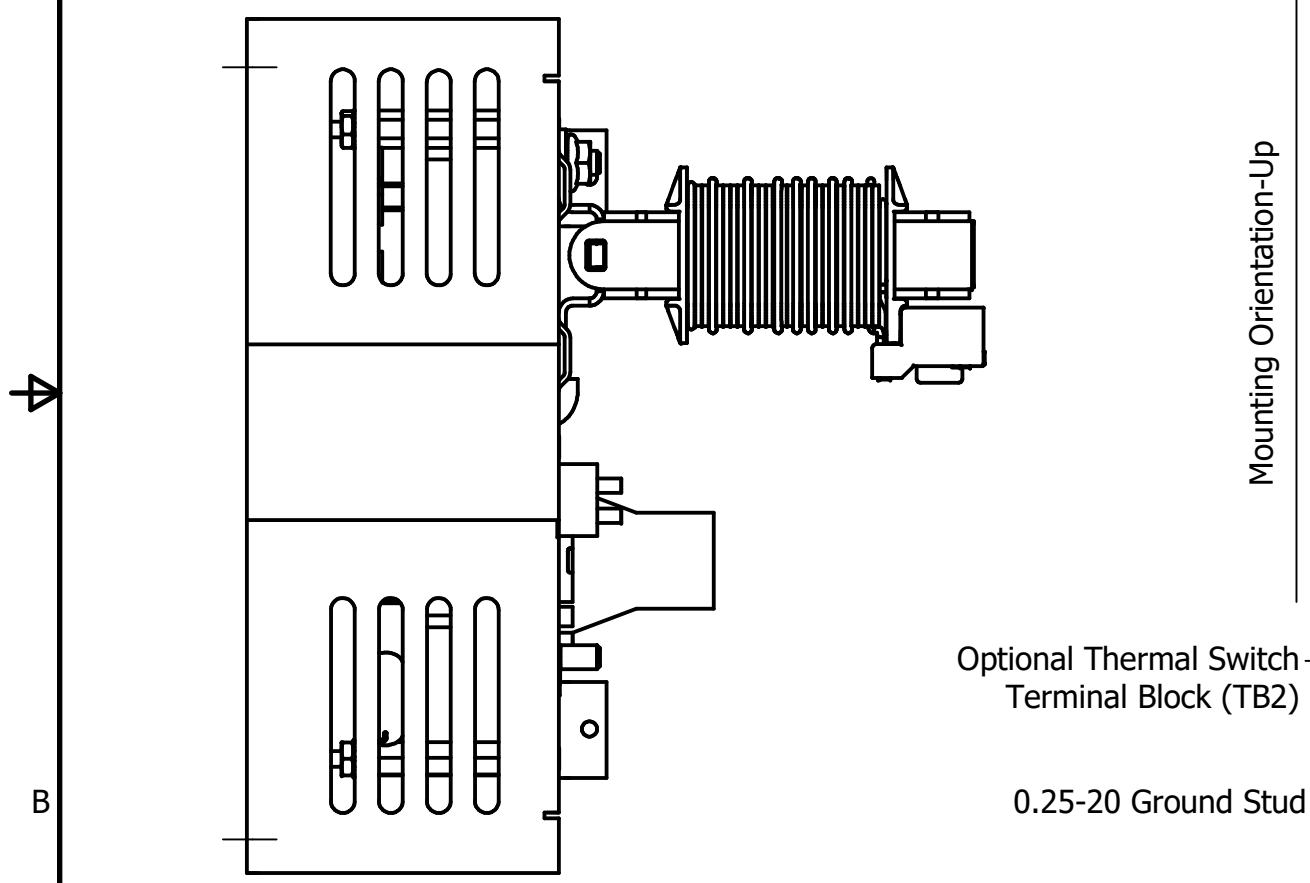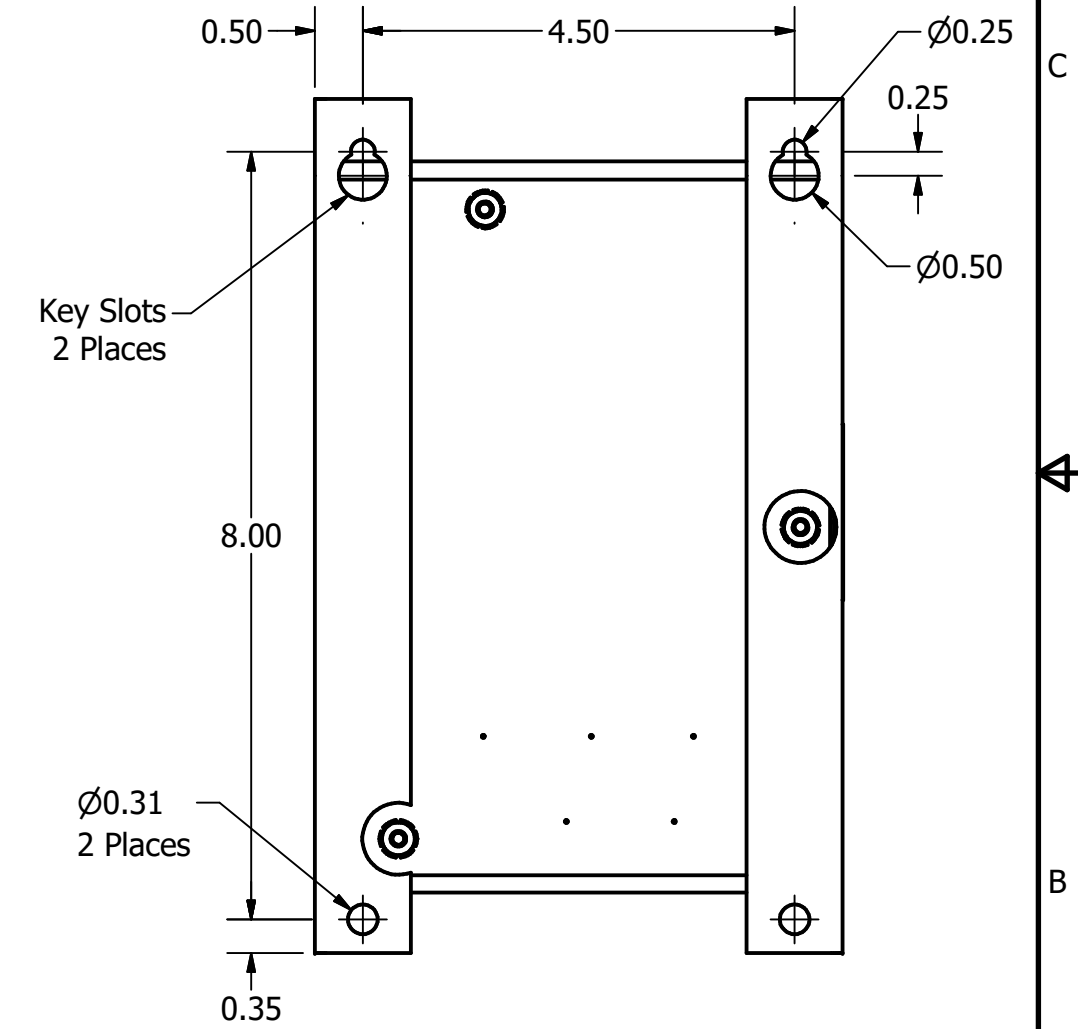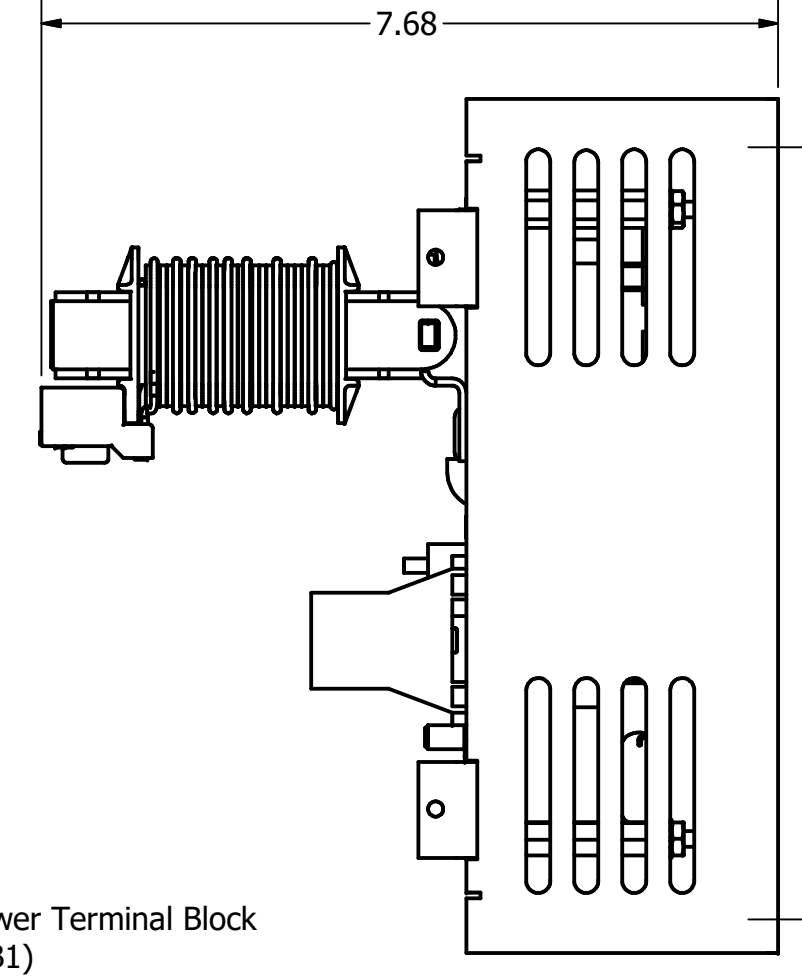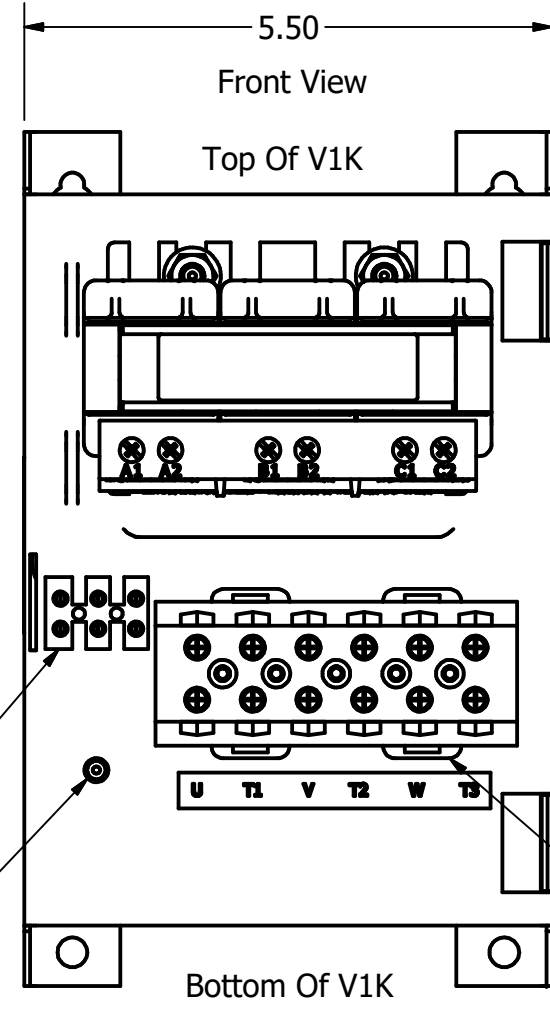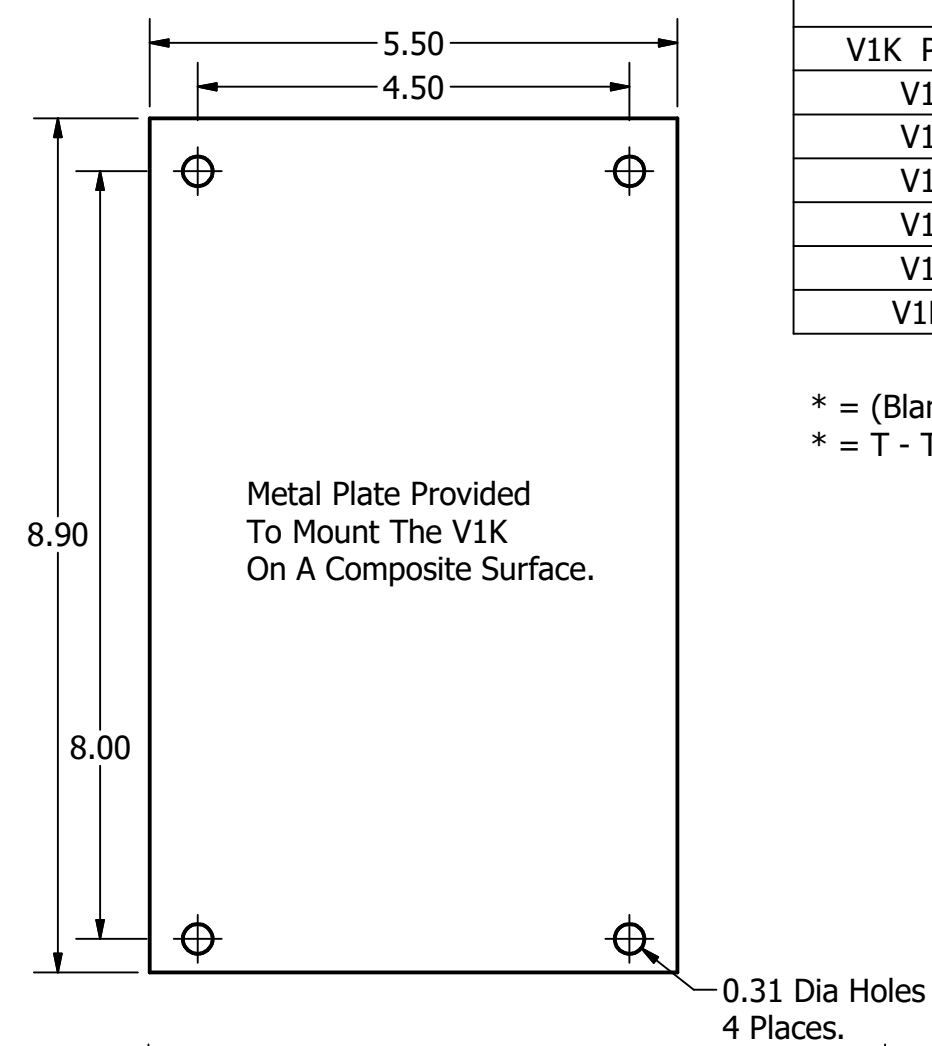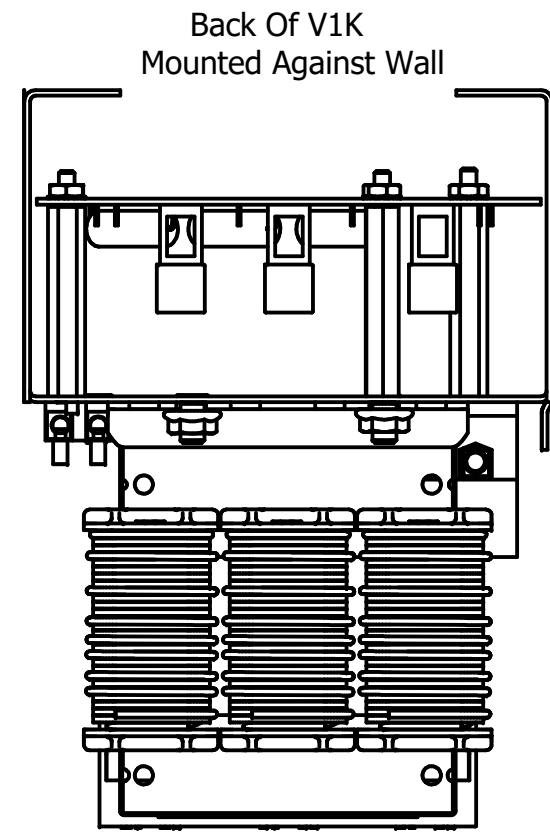

(Customer Connections) Markings On Terminal Block For Reference Only.

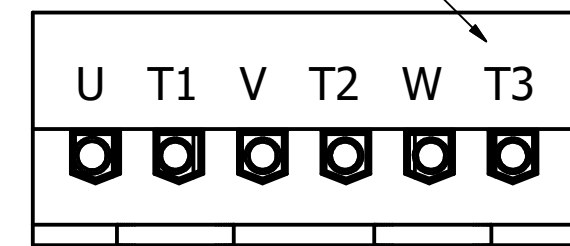

Customer Is Responsible For Installation to Meet All National And Local Electrical Codes.

Material(s) Shall be RoHS Compliant

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.

TOLERANCES (EXCEPT AS NOTED)			
DECIMAL			
	.XX ± .25		
	.XXX ± .10		
FRACTIONAL			
	± 1/32		
ANGULAR			
	± 1°		
A	As Designed	03/11/21	JRN
NO	REVISION	DATE	BY

DRN
J
SCAL